



Expanding Your Solutions

**Corporate Headquarters**  
13191 Crossroads Pkwy N., Ste 325  
City of Industry, CA 91746  
Phone: 800.775.2362  
Fax: 626.330.7598  
www.cemcosteel.com

**Manufacturing Facilities**  
City of Industry, CA  
Denver, CO  
Ft. Worth, TX  
Pittsburg, CA

**Structural Engineering/Design**  
1001-A Pittsburgh Antioch Hwy  
Pittsburg, CA 94565  
Phone: 800.775.2362  
Fax: 626.330.7598  
www.cemcoengineering.com

**Technical Services**  
13191 Crossroads Pkwy N., Ste 325  
City of Industry, CA 91746  
Phone: 800.416.2278  
Fax: 626.249.5004

## 600VS125-15 (25EQ) VIPERSTUD

### Geometric Properties

6" x 1-1/4" flange, 15 mil ViperStuds are manufactured from standard G40 hot-dipped galvanized steel. G60 and G90 coatings are available through special order, and may require up-charges and extended lead times.

### Steel Thickness

| Model No.          | Design Thickness (in) | Minimum Thickness (in) | Yield (ksi) | "W" Web Sizes (in) | Coating <sup>4,5</sup> | Flange (in) | "L" Return Lip (in) |
|--------------------|-----------------------|------------------------|-------------|--------------------|------------------------|-------------|---------------------|
| 600VS125-15 (25EQ) | 0.0155                | 0.0147                 | 50          | 6                  | G40                    | 1-1/4       | 1/4                 |

**Notes:** 1. Uncoated steel thickness. Thickness is for carbon sheet steel. 2. Minimum thickness represents 95% of the design thickness and is the minimum acceptable thickness. 3. Knockout size for 6" Stud is 1-1/2" x 2-1/2". 4. Per ASTM C645 & A1003, Table 1. 5. G60 and G90 available upon request. Will require extended lead time and upcharge.


**Color Code (painted on ends):** 15 mil: None with Dark Grey band on pallet

### ASTM & Code Standards:

- ASTM A653/A653M, A924/A924M, A1003/1003, C645 & C754
- ICC-ES & SFIA Code Compliance Certification Program
- ICC ESR-2620                      ■ CBC: 2013, 2016, 2019
- IBC: 2012, 2015, 2018, 2021   ■ AISI: S100, S220

### LEED v4 for Building and Design Construction

- MR Prerequisite: Construction and Demolition Waste Management Planning.
- MR Credit: Construction and Demolition Waste Management.
- MR Credit: Building Product Disclosure and Optimization – Sourcing of Raw Materials, Option 2.
- MR Credit: Building Product Disclosure and Optimization – Environmental Product Declarations, Options 1 & 2.
- MR Credit: Building Product Disclosure and Optimization – Material Ingredients, Option 1.
- MR Credit: Building Life-Cycle Impact Reduction, Option 4.

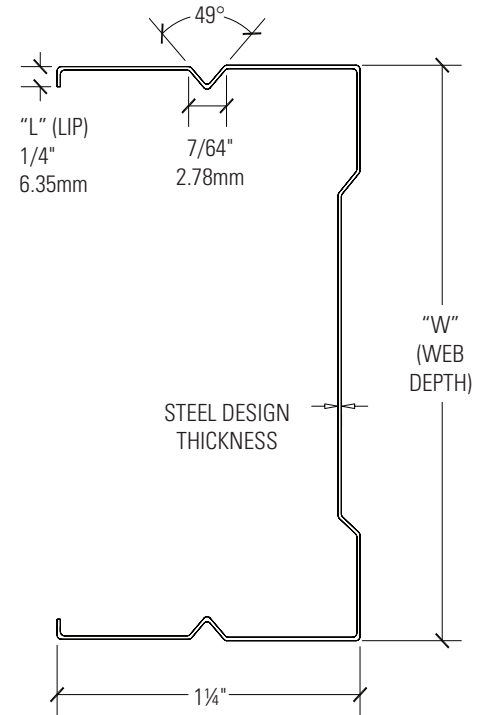

### 600VS125-15<sup>5</sup> (25EQ)ViperStud Properties

| Design (in) | Min (in) | Yield (ksi) | Weight (lb/ft) | Gross Properties        |                                   |                     |                                   |                     | Effective Properties               |                                   | Moment                     |   |  |  | Critical Unbraced Length <sup>7</sup> Lu (in) |
|-------------|----------|-------------|----------------|-------------------------|-----------------------------------|---------------------|-----------------------------------|---------------------|------------------------------------|-----------------------------------|----------------------------|---|--|--|---|
|             |          |             |                | Area (in <sup>2</sup> ) | I <sub>x</sub> (in <sup>4</sup> ) | r <sub>x</sub> (in) | I <sub>y</sub> (in <sup>4</sup> ) | r <sub>y</sub> (in) | I <sub>xd</sub> (in <sup>4</sup> ) | S <sub>x</sub> (in <sup>3</sup> ) | Allowable Moment Ma (in-k) | Local Buckling Nominal Moment <sup>2</sup> Viper Mnl (in-k) | Distortional Buckling Nominal Moment <sup>2</sup> Viper Mnd (in-k) | Nominal Moment for Conventional Studs <sup>3</sup> Mn (in-k) |   |
| 0.0155      | 0.0147   | 50          | 0.37           | 0.108                   | 0.250                             | 1.520               | 0.020                             | 0.429               | 0.255                              | 0.061                             | 1.69                       | 3.06  | 3.06   | 2.74 (18 mil)  | 24.4  |

**Notes:** 1. Section properties are in accordance with AISI S100 & S220. Viper 25 and Viper20 section properties are based on testing. Allowable moment (Ma) is calculated with a safety factor of 1.81 in accordance with Chapter F of AISI S100 & S220 specification. 2. Nominal moment for Viper 18 mil, Viper 30 mil, and Viper 33 mil conventional studs are based on calculations in accordance with AISI S100 & S220. Allowable moments (Ma) can be calculated with a 1.67 safety factor. 3. Section properties are in accordance with AISI: S100, S220. 4. Web depth-to-thickness ratio exceeds 200. 5. Web depth-to-thickness ratio exceeds 260. 6. ViperStud is considered fully braced when unbraced length is less than listed Lu. 7. KΦ assumed to be zero for distortional buckling moments.

### Non-Composite Limiting Heights – Braced at 48" O.C.

| Depth (in) | Gauge | Member Designation | Design (in) | Min (in) | Yield (ksi) | Spacing (o.c.) | 5 PSF    |          |          | 7.5 PSF |         |         | 10 PSF  |         |         |
|------------|-------|--------------------|-------------|----------|-------------|----------------|----------|----------|----------|---------|---------|---------|---------|---------|---------|
|            |       |                    |             |          |             |                | L/120    | L/240    | L/360    | L/120   | L/240   | L/360   | L/120   | L/240   | L/360   |
| 6          | 25EQ  | 600VS125-15 (25EQ) | 0.0155      | 0.0147   | 50          | 12             | 14'-1" w | 14'-1" w | 14'-1" w | 9'-5" w | 9'-5" w | 9'-5" w | 7'-1" w | 7'-1" w | 7'-1" w |
|            |       | 600VS125-15 (25EQ) | 0.0155      | 0.0147   | 50          | 16             | 10'-7" w | 10'-7" w | 10'-7" w | 7'-1" w | 7'-1" w | 7'-1" w | --      | --      | --      |
|            |       | 600VS125-15 (25EQ) | 0.0155      | 0.0147   | 50          | 24             | 7'-1" w  | 7'-1" w  | 7'-1" w  | --      | --      | --      | --      | --      | --      |

**Notes:** 1. Limiting heights are in accordance with AISI S100 & S220 using all steel non-composite design. 2. Limiting heights are established by considering flexure, shear, web crippling, and deflection. The web crippling values are based on testing with a bearing length of 1". 3. For bending, studs are assumed to be adequately braced to develop full allowable moment. Studs are considered fully braced when unbraced length is less the Lu. 4. Viper25 & Viper20 distortional & local buckling moments and stiffness are based on testing in accordance with App. A of a non-structural code compliance program. 5. For web crippling, when h/t<sub>s</sub> < 200, the web crippling values are computed based on section C3.4.2 of AISI S100 & S220, when h/t<sub>s</sub> > 200, the web crippling values are based on testing with a bearing length of 1" and fastened to support. 6. Web stiffeners are required for studs with h/t<sub>s</sub> > 200, web crippling and shear values have been confirmed by testing. **Fully braced when unbraced length is less than Lu. See section properties table for Lu values.** 7. The factory punchouts

are in accordance with section C5 of AISI S100 & S220. The distance from the center of the last punchout to the end of the stud is 12".

"f" - flexure controls; "s" - shear controls; "w" - web crippling controls. No letter next to the number means deflection controls.



Expanding Your Solutions

**Corporate Headquarters**  
13191 Crossroads Pkwy N., Ste 325  
City of Industry, CA 91746  
Phone: 800.775.2362  
Fax: 626.330.7598  
www.cemcosteel.com

**Manufacturing Facilities**  
City of Industry, CA  
Denver, CO  
Ft. Worth, TX  
Pittsburg, CA

**Structural Engineering/Design**  
1001-A Pittsburgh Antioch Hwy  
Pittsburg, CA 94565  
Phone: 800.775.2362  
Fax: 626.330.7598  
www.cemcoengineering.com

**Technical Services**  
13191 Crossroads Pkwy N., Ste 325  
City of Industry, CA 91746  
Phone: 800.416.2278  
Fax: 626.249.5004

## 600VS125-15 (25EQ) VIPERSTUD

PAGE 2

### Non-Composite Limiting Heights – Fully Braced

| Depth (in) | Gauge | Member Designation | Design (in) | Min (in) | Yield (ksi) | Spacing (o.c.) | 5 PSF    |          |          | 7.5 PSF  |          |          | 10 PSF   |          |          |
|------------|-------|--------------------|-------------|----------|-------------|----------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
|            |       |                    |             |          |             |                | L/120    | L/240    | L/360    | L/120    | L/240    | L/360    | L/120    | L/240    | L/360    |
| 6          | 25EQ  | 600VS125-15 (25EQ) | 0.0155      | 0.0147   | 50          | 12             | 17'-8" f | 17'-8" f | 17'-7" f | 14'-1" w | 14'-1" w | 14'-1" w | 10'-7" w | 10'-7" w | 10'-7" w |
|            |       | 600VS125-15 (25EQ) | 0.0155      | 0.0147   | 50          | 16             | 15'-5" f | 15'-5" f | 15'-5" f | 10'-7" w | 10'-7" w | 10'-7" w | 7'-11" w | 7'-11" w | 7'-11" w |
|            |       | 600VS125-15 (25EQ) | 0.0155      | 0.0147   | 50          | 24             | 10'-7" w | 10'-7" w | 10'-7" w | 7'-0" w  | 7'-0" w  | 7'-0" w  | --       | --       | --       |

**Notes:** 1. Limiting heights are in accordance with AISI S100 & S220 using all steel non-composite design. 2. Limiting heights are established by considering flexure, shear, web crippling, and deflection. The web crippling values are based on testing with a bearing length of 1". 3. For bending, studs are assumed to be adequately braced to develop full allowable moment. Studs are considered fully braced when unbraced length is less than Lu. 4. Viper25 & Viper20 distortional & local buckling moments and stiffness are based on

testing in accordance with App. A of a non-structural code compliance program. 5. For web crippling, when  $h/t \leq 200$ , the web crippling values are computed based on AISI S100 & S220, when  $h/t > 200$ , the web crippling values are based on testing with a bearing length of 1" and fastened to support. 6. Web stiffeners are required for studs with  $h/t \geq 200$ , web crippling and shear values have been confirmed by testing. **Fully braced when unbraced length is less than Lu. See section properties table for Lu values.**

7. The factory punchouts are in accordance with section C5 of AISI S100 & S220. The distance from the center of the last punchout to the end of the stud is 12".

"f" - flexure controls; "s" - shear controls; "w" - web crippling controls. No letter next to the number means deflection controls.

### Allowable Composite Heights for Non-Load Bearing Walls

| Depth (in) | Gauge | Member Designation | Design (in) | Min (in) | Yield (ksi) | Spacing (o.c.) | 5 PSF   |         |        | 7.5 PSF |         |        | 10 PSF |         |        |
|------------|-------|--------------------|-------------|----------|-------------|----------------|---------|---------|--------|---------|---------|--------|--------|---------|--------|
|            |       |                    |             |          |             |                | L/120   | L/240   | L/360  | L/120   | L/240   | L/360  | L/120  | L/240   | L/360  |
| 6          | 25EQ  | 600VS125-15 (25EQ) | 0.0155      | 0.0147   | 50          | 12             | 24'-8"  | 23'-9"  | 21'-1" | 22'-3"  | 20'-9"  | 18'-5" | 20'-0" | 18'-10" | 16'-9" |
|            |       | 600VS125-15 (25EQ) | 0.0155      | 0.0147   | 50          | 16             | 22'-11" | 21'-7"  | 19'-2" | 20'-0"  | 18'-10" | 16'-9" | 17'-5" | 17'-2"  | 15'-3" |
|            |       | 600VS125-15 (25EQ) | 0.0155      | 0.0147   | 50          | 24             | 20'-0"  | 18'-10" | 16'-9" | 16'-5"  | 16'-5"  | 14'-8" | 13'-6" | 13'-6"  | 13'-0" |

**Notes:** 1. Viper composite limiting heights are based on testing in accordance with ICC-ES acceptance criteria AC86. 2. Mechanical fastening of gypsum panel to the stud and track is required, except when installing a minimum 30 mil slotted track with 2-1/2" legs in lieu of standard track. 3. Viper composite limiting heights based on a single layer of 5/8" Type X gypsum board applied

vertically to both sides of the wall over full height. 5/8" Type X wallboard from the following manufacturers are acceptable: USG, National, Georgia Pacific, CertainTeed, American and Continental. 4. For deflection track usage contact Technical Services. 5. Review fire related assemblies for any additional requirements.

### Allowable Ceiling Spans

| L/240              |        | 4 PSF Lateral Support of Compression Flange |          |          |                                  |          |          | 6 PSF Lateral Support of Compression Flange |          |         |                                  |          |          |
|--------------------|--------|---|----------|----------|----------------------------------|----------|----------|---|----------|---------|----------------------------------|----------|----------|
| Member             | Fy ksi | Unsupported Joist Spacing (in.) O.C.        |          |          | Midspan Joist Spacing (in.) O.C. |          |          | Unsupported Joist Spacing (in.) O.C.        |          |         | Midspan Joist Spacing (in.) O.C. |          |          |
|                    |        | 12  | 16       | 24       | 12                               | 16       | 24       | 12  | 16       | 24      | 12                               | 16       | 24       |
| 600VS125-15 (25EQ) | 50     | 10'-8" f                                    | 9'-11" f | 8'-11" f | 14'-4" f                         | 13'-2" f | 11'-8" f | 9'-7" f                                     | 8'-11" f | 8'-1" f | 12'-9" f                         | 11'-8" f | 8'-10" w |

| L/360              |        | 4 PSF Lateral Support of Compression Flange |          |          |                                  |          |          | 6 PSF Lateral Support of Compression Flange |          |         |                                  |          |          |
|--------------------|--------|---|----------|----------|----------------------------------|----------|----------|---|----------|---------|----------------------------------|----------|----------|
| Member             | Fy ksi | Unsupported Joist Spacing (in.) O.C.        |          |          | Midspan Joist Spacing (in.) O.C. |          |          | Unsupported Joist Spacing (in.) O.C.        |          |         | Midspan Joist Spacing (in.) O.C. |          |          |
|                    |        | 12  | 16       | 24       | 12                               | 16       | 24       | 12  | 16       | 24      | 12                               | 16       | 24       |
| 600VS125-15 (25EQ) | 50     | 10'-8" f                                    | 9'-11" f | 8'-11" f | 14'-4" f                         | 13'-2" f | 11'-8" f | 9'-7" f                                     | 8'-11" f | 8'-1" f | 12'-9" f                         | 11'-8" f | 8'-10" w |

**Notes:** 1. Ceiling Spans are in accordance with AISI S100 & S220 using all steel non-composite design. 2. Ceiling Spans are established by considering flexure, shear, web crippling, and deflection. 3. For web crippling, when  $h/t \leq 200$ , the web crippling values are computed based on AISI S100 & S220. When  $h/t > 200$ , the web crippling values are based on testing with a bearing length of 1". 4. No web stiffeners are required for studs with  $h/t > 200$ , web

crippling and shear values have been confirmed by testing. 5. All values are for simple spans, with compression flange either unbraced or braced at mid-span. 6. Ceiling spans are based on total load of assembly, not including storage or live load for accessible ceilings. 7. The factory punchouts are in accordance with AISI S100 & S220. The distance from the center of the last punchout to the end of the stud is 12".

"f" - flexure controls; "s" - shear controls; "w" - web crippling controls. No letter next to the number means deflection controls.

### CEMCO cold-formed steel framing products contain 30% to 37% recycled steel.

■ Total Recycled Content: 36.9% ■ Post-Consumer: 19.8% ■ Pre-Consumer: 14.4%

#### CSI Division:

■ 09.22.16 – Non-Structural Metal Framing

Check the updated list of Certified Production Facilities at Intertek's website at <http://www.intertek.com/building/sfia>



This technical information reflects the most current information available and supersedes any and all previous publications effective February 8, 2023.

02-08-23 AT