



## INTERMAT

2045 Placentia Avenue

Costa Mesa, California 92627

[www.sureboard.com](http://www.sureboard.com)

[support@sureboard.com](mailto:support@sureboard.com)

## SURE-BOARD® SERIES 200, 200W, AND 200B STRUCTURAL PANELS INSTALLED ON COLD-FORMED STEEL OR WOOD FRAMED SHEAR WALLS

### CSI Section:

05 16 0 Metal Framing Systems

### 1.0 RECOGNITION

Intermat's Sure-Board® Series 200, 200W, and 200B Structural Panels recognized in this report has been evaluated for use as shear panels for wood or steel light-frame walls. The structural performance properties of the Sure-Board® Series 200, 200W, and 200B Structural Panels complies with the intent of the provisions of the following codes and regulations:

- 2018, 2015, 2012, and 2009 International Building Code® (IBC)
- 2018, 2015, 2012, and 2009 International Residential Code® (IRC)
- 2019 and 2016 California Building Code® (CBC)  
-- Attached Supplement

### 2.0 LIMITATIONS

Use of the Sure-Board® Series 200, 200W, and 200B Structural Panels recognized in this report is subject to the following limitations:

**2.1** Panels are manufactured, identified and installed in accordance with this report.

**2.2** The Nominal ( $V_n$ ) and Allowable Stress Design ( $V_{asd}$ ) shear values for shear walls are limited to the values noted in Tables 1, 1A, 2, 3, 4, 5, and 6 of this report. To determine the design strength values, the appropriate strength reduction factor, in accordance with 2018 IBC Section 2211.1, 2015, 2012 IBC Section 2211.6, 2009 IBC Section 2210.6, or Chapter 23 of the IBC, or Section R301.1.3 of the IRC shall be applied.

**2.3** Plans and calculations demonstrating compliance with codes listed in Section 1.0 of this report and this report shall be submitted to the building official for approval.

**2.4** Applied loads shall be adjusted in accordance with Section 1605 of the IBC. Calculations shall demonstrate in addition to other requirements as stipulated by the building official, that the applied loads are less than the design loads described in the IBC, or IRC and this report.

**2.5** All nominal and allowable load capacities provided to this report do not include 1.33 stress increase. The 1.33 increase for transient loads shall not be applied to allowable shear loads for these products.

**2.6** The panels are produced at CEMCO, MARINO WARE, and INTERMAT facilities.

### 3.0 PRODUCT USE

**3.1 General:** Sure-Board® Series 200, 200W, and 200B Structural Panels are panels attached to cold-formed steel (CFS) or wood framing for shear wall applications within a Seismic Force-Resisting System conforming to items A.13 in Table 12.2-1 of ASCE/SEI 7-05, and A.15 and A.16 in Table 12.2-1 of ASCE/SEI 7-10 or ASCE/SEI 7-16; or a Wind Force Resisting System.

The structural panels are alternatives to cold-formed steel or wood stud light-frame shear wall systems described in Section 2211.1 of the 2018 International Building Code (IBC), Section 2211.6 of the 2015 and 2012 International Building Code (IBC), Section 2210.6 of the 2009 International Building Code (IBC), Section 2305 of the International Building Code (IBC), Section 12.2 of ASCE/SEI 7, and Sections R602 and R603 of the IRC. The structural panels may also be used where an engineered design is submitted in accordance with Section R301.1.3 of the International Residential Code (IRC).

### 3.2 Design:

#### 3.2.1 Shear Wall Design

**3.2.1.1** Seismic loadings shall be determined in accordance with IBC Section 1613 and ASCE/SEI 7 subject to limitations set forth for Seismic Force-Resisting Systems conforming to items A.13 in Table 12.2-1 of ASCE/SEI 7-05, and A.15 and A.16 in Table 12.2-1 of ASCE/SEI 7-10 or ASCE/SEI 7-16. The shear walls shall be limited to height limits and seismic categories listed in ASCE/SEI 7, Table 12.2-1, for the respective light frame shear wall bearing wall system.

Wind loadings shall be determined in accordance with IBC Section 1609 and ASCE/SEI 7.



**3.2.1.2** The Nominal ( $V_n$ ) and Allowable Stress Design ( $V_{asd}$ ) shear values for wind and earthquake forces are shown in Tables 1, 1A, 2, 3, 4, 5, and 6 of this report with associated deflections for shear walls using Sure-Board® Series 200, 200W, and 200B Structural Panels attached to Cold-Formed Steel or Wood studs. Nominal shear values shall be multiplied by the appropriate strength reduction factor to determine LRFD design strength in accordance with footnote 4 of Tables 1, 1A, 2, 3, 4, 5, and 6 of this report as set forth in 2018 Section 2211.1, 2015 and 2012 IBC Section 2211.6, 2009 IBC Section 2210.6, Chapter 23 of the IBC, and R301.1.3 of the IRC.

**3.2.1.3 Design Deflection:** The deflection of a 200 or 200W shear wall fastened throughout on steel stud framing shall be permitted to be calculated in accordance with Eq. 4.1.3. Eq. 4.1.3 shall not be used to estimate deflection for shear strengths exceeding the tabulated nominal values in this report:

$$\Delta = \frac{2vh^3}{3E_s A_c b} + \omega_1 \omega_2 \left( \frac{vh}{\rho G t_{s\_SB}} \right) + (\omega_1)^{1.25} \omega_2 \omega_3 \omega_4 \left( \frac{v}{\beta} \right)^\alpha + \left( \frac{h}{b} \right) \delta_{anchorage} \quad (Eq. 4.1.3)$$

Where

$A_c$  = Gross cross-sectional area of chord/boundary studs, in<sup>2</sup> (mm<sup>2</sup>)

$b$  = Width of shear wall, in. (mm)

$E_s$  = Modulus of elasticity of steel, 29,500,000 psi (203,000 MPa)

$F_y$  = minimum specified yield strength of steel sheet in the Sure-Board sheathing, psi (MPa)

$G$  = Shear modulus of steel in the Sure-Board sheathing, 11,300,000 psi (78,000 MPa)

$h$  = Wall height, in. (mm)

$s$  = Fastener spacing at panel edges, in. (mm)

$t_{s\_SB}$  = Sure-Board sheathing steel design thickness, in. (mm)

$t_{s\_F}$  = Cold-formed steel framing design thickness, in. (mm)

$v$  = Shear demand ( $V/b$ ), lb/in (N/mm)

$V$  = Total lateral load applied to the shear wall, lb (N)

$\Delta$  = Calculated deflection, in. (mm)

$\delta_{anchorage}$  = Vertical deformation from anchorage system, in. (mm)

$\rho = 1.0$

$\beta$  = product specific inelastic stiffness factor, lb/in/in<sup>1/α</sup>, in Table 4.1.3 of this report.

$\alpha$  = product specific inelastic stiffness multiplier, in Table 4.1.3 of this report.

$\omega_1 = s/(6 \text{ in.}) \{s/152.4 \text{ mm}\}$

$\omega_2 = (0.0346 \text{ in.})/t_{s\_F} \{(0.8788 \text{ mm})/t_{s\_F}\}$

$\omega_3 = [(h/b)/2]^{0.5}$

$\omega_4 = [(33,000 \text{ psi})/F_y]^{0.5} \{[(228 \text{ MPa})/F_y]^{0.5}\}$

**Table 4.1.3 -- Sure-Board Shear Wall Deflection Parameters**

Parameter	Sure-Board Series 200	Sure-Board Series 200W
$\alpha$	2.566	2.359
$\beta$ [(lb./in.)/(in. <sup>1/α</sup> )]	126.16	107.73
$\beta$ [(N/mm)/(mm <sup>1/α</sup> )]	6.263	4.788

**3.2.1.4** The maximum shear-wall height-to-width ratio is 2¼:1. Panels shall be fastened in accordance with footnote 2 of Tables 1, 1A, 2, 3, 4, 5, and 6 of this report, as applicable.

**3.2.1.5** Design of shear wall connections, such as uplift hold-downs, shear to base anchorage and shear transfer from horizontal elements are beyond the scope of this report and the design professional shall provide appropriate design and detailing information to the Building official. The collector shall be designed in accordance to and comply with the IBC or the IRC and be sized to exceed the loads resisted by the shear wall.

### 3.2.2 Load Bearing and Non-Load Bearing Wall Design

**3.2.2.1 General:** Cold-Formed Steel or Wood framing design for out-of-plane and axial loads shall comply with the IBC or IRC, as applicable. For installation in Seismic Design Categories C, D, E, and F, additional requirements in 2018 Sections 2211.1.1.1 and 2211.1.1.2, 2015 and 2012 IBC Section 2211.6, 2009 IBC Section 2210.6, Chapter 23 of the IBC, or IRC, AISI S100, and ASCE/SEI 7 apply.

**3.2.2.2 Diaphragm to Wall:** Table 8 of this report provides gravity load shear transfer nominal strength values for five different diaphragm-to-wall framing details/conditions—Cases 1 through 5. Cases 2 through 5 provide for a Sure-Board® Series 200-5/8 in. Type X gypsum composite panel, a Sure-Board® Series 200-5/8 in. Type X gypsum composite panel with the gypsum panel terminating below joists and the steel sheet extending along the joist, or a 54-mil steel sheet/plate to be interposed/sandwiched between the diaphragm ledger and the wall framing. The strength values in Table 8 of this report are applicable for the specific configuration described.

### 3.3 Installation:

**3.3.1 Installation General:** The panels shall be directly applied to the studs at interior and exterior shear walls and are limited to applications where there is no continuous direct exposure to the weather or damp environments other than during construction. Construction exposure shall not exceed the board (gypsum, cement, or fiberboard) manufacturer’s recommendations or shall be protected during construction from direct moisture exposure to



gypsum. In areas that may be exposed to possible moisture intrusion, water resistant sheathing is required. Sure-Board® products may be installed as specified by the registered design professional on assemblies as permitted by the IBC or IRC in all Seismic Design Categories.

### 3.3.2 Steel Framing

**3.3.2.1** Installation shall be in accordance with this report and the manufacturer's published Installation and Cutting Sure-Board® Series 200, 200W, and 200B instructions. Where conflicts occur, the more restrictive shall govern. Field repair of Sure-Board® Series 200, 200W, and 200B panels with surface damaged gypsum wallboard may be accomplished following Section 3 of *Installation and Cutting Sure-Board® Series 200, 200W, and 200B*, available from the manufacturer upon request or online at [www.sureboard.com](http://www.sureboard.com)

**3.3.2.2** Sure-Board® Series 200, 200W, and 200B Structural Panels shall be placed with the long dimension parallel or perpendicular to steel stud framing. The steel face shall be in contact with the framing. All panel edges (top and bottom) shall be fully blocked by framing studs, track, blocking, or flat straps of the same gage as the framing material and include an end collector element to be determined by the Design Professional in accordance with the IBC, IRC, the AISI S100, and the ASCE/SEI 7 seismic provisions. Minimum required collector elements are defined in Section 4.3.3 of this report and are required at both shear wall ends. Maximum stud spacing shall not exceed 24 inches (610 mm) on center. Screws attaching panels shall be installed in one operation through the panels into the framing. Screws or pneumatic pin heads are required to be located 3/8-inch (9.53 mm) minimum from panel edges. Screw heads shall be driven flush with surface. Screws shall penetrate at least three exposed threads into framing members.

**3.3.2.3** A minimum panel size of 16 inches by 96 inches (406 mm by 2438 mm) is acceptable, provided all perimeter edges are fastened to framing members at the required spacing. All panels may be fastened at panel joint stud without staggering the fasteners at each panel. No panels shall be lapped over another at these lap joint studs. Joint spacing between panels shall range from 0 inch to 1/8-inch (0 to 3.2 mm). Top and Bottom track gaps to floors or ceilings are not limited except that panels shall have at least 1 inch (25.4 mm) minimum track leg height behind panel edges, without adding additional backing for fasteners. The designed fastener spacing shall apply to each panel edge. No panel edges shall be lapped and attached with a single row of fasteners.

**3.3.2.4** Holes cut in Sure-Board® panels shall be approved by the building official based on the recommendations supplied by manufacturer and as recommended by the

Design Professional.

### 3.3.3 Wood Framing

**3.3.3.1** Installation shall be in accordance with this report and the manufacturer's published installation instructions. Field repair of Sure-Board® Series 200 Structural Panels with surface damaged gypsum wallboard may be accomplished following Section 3 of *Installation and Cutting Sure-Board® Series 200 and 200W*, available from the manufacturer upon request or online at [www.sureboard.com](http://www.sureboard.com)

**3.3.3.2** Sure-Board® Series 200, 200W and 200B Structural Panels shall be placed with the long dimension parallel or perpendicular to stud framing. The steel face shall be in contact with the framing. All panel edges shall be fully blocked by framing studs, blocking or plates. Maximum stud spacing as tested shall not exceed 24 inches (610 mm) on center. Nail and screw heads are required to be located 3/8-inch (9.53 mm) minimum from panel edges. Nail and screw heads shall be installed flush with surface of MDF, non-combustible sheathing or gypsum wallboard to accommodate application of finish material where required.

After Sure-Board® Series 200 or 200B panels have been installed and fastened completely to framing members, steel structural strapping may be installed by scoring the gypsum sheathing and removing the gypsum material as necessary from steel sheet where strap is placed. After the gypsum material has been removed, the steel structural strapping may be installed over Sure-Board® steel sheathing and fastened in accordance with the strap manufacturer's instructions and approved plans, into required backing or framing and inspected. After inspection, the gypsum may be patched back in and fastened to Sure-Board® steel sheet or framing and taped and finished by gypsum board applicator to required level of finish without causing any adverse structural effect or unwanted buildup under the steel sheet of the Sure-Board® panels.

**3.3.3.3** A minimum panel size of 16 inches by 96 inches (406 mm by 2438 mm) is acceptable provided all perimeter edges are fastened to framing members at the required spacing. All panels may be fastened at panel joint stud without staggering the fasteners at each panel. No panels shall be lapped over another at these lap joint studs. Joint spacing between panels shall range from 0 inch to 1/8-inch (0 to 3.2 mm). Top and Bottom plate gaps to floors or ceilings are not limited except that panels shall have at least 1 inch (25.4 mm) minimum plate thickness behind panel edge, without adding additional blocking for fasteners. The designated fastener spacing applies to each panel edge. No panel edges may be lapped and attached with a single row



of fasteners.

**3.3.3.4** Holes cut in Sure-Board® panels shall be approved by the building official based on the recommendations supplied by manufacturer and as recommended by the Design Professional.

### 3.4 Special Inspections

When required by the building official, periodic special inspections for seismic or wind resistance shall be in accordance with the requirements of IBC Chapter 17 corresponding to the applicable type (wood or cold-formed steel) of light-framed construction.

## 4.0 PRODUCT DESCRIPTION

### 4.1 Sure-Board® Series 200, 200W, and 200B Series Structural Panels

**4.1.1 Sure-Board® Series 200 Panels:** Sure-Board® Series 200 Structural Panels consist of ½- to ¾-inch thick (12.7 to 19.0 mm), tapered or square-edged, non-rated or Type-X fire-resistance-rated gypsum wallboard complying with ASTM C1396, C1278 or C1177, or cement board complying with ASTM C1325; or ¾ -inch thick (19.0 mm) USG Ultracode Gypsum Wallboard, factory-laminated with water-soluble adhesive to sheet steel. The sheet steel is No. 22 gage (0.027 inch/0.686 mm) minimum base-metal thickness complying with ASTM A653 CS, Grade 33 minimum, and is provided with a G40 hot-dipped galvanized coating conforming to ASTM A924. These panels are available in widths of 48 inches (1219 mm) and standard lengths of 8, 9, 10 and 12 feet (2438, 2743, 3048 and 3658 mm).

**4.1.2 Sure-Board® Series 200W Panels:** Sure-Board® Series 200W Structural Panels consist of minimum ⅛-inch (3.2 mm) thick, square-edge Medium Density Fiberboard (MDF) panels, or equal, complying with ANSI A208.2; or magnesium oxide panels, factory-laminated with a water-soluble adhesive to sheet steel. The sheet steel is No. 22 gage (0.027 inch/0.686 mm) minimum base-metal thickness complying with ASTM A653 CS, Grade 33 minimum, and is provided with a G40 hot-dipped galvanized coating conforming to ASTM A924. These panels are available in widths of 48 inches (1219 mm) and standard lengths of 8, 9, 10 and 12 feet (2438, 2743, 3048 and 3658 mm) and the standard lengths may be pre-cut by request.

**4.1.3 Sure-Board® Series 200B Panels:** Sure-Board® Series 200B Structural Panels consist of ½- to ¾-inch thick (12.7 to 19.0 mm), tapered or square-edged, non-rated or Type X fire-resistance-rated gypsum wallboard complying with ASTM C1396, C1278 or C1177, or cement board complying with ASTM C1325, factory-laminated with

water-soluble adhesive to sheet steel. The sheet steel is No. 14 gage (0.071 inch/1.81 mm) minimum base-metal thickness complying with ASTM A653 CS, Grade 50 minimum, and is provided with a G60 hot-dipped galvanized coating conforming to ASTM A924. These panels are available in widths of 48 inches (1219 mm) and standard lengths of 8, 9, 10 and 12 feet (2438, 2743, 3048 and 3658 mm).

### 4.2 Fasteners

**4.2.1 Sure-Board® Series 200 Panels Attached to Steel Framing (Tables 1 and 1A):** The fasteners used for attaching the Sure-Board® Series 200 Structural Panels to steel framing are self-drilling/self-tapping No. 2 pilot point flat head, S12 drill point screws. The No. 8 screws have a minimum diameter of 0.138-inch (3.5 mm), with a minimum 0.3145-inch (8.0 mm) head diameter and 1.25 inch (31.7 mm) minimum length, and shall comply with SAE J78, ASTM C954 and C1513.

**4.2.2 Sure-Board® Series 200W Panels Attached to Steel Framing (Tables 2 and 3):** The fasteners used for attaching the Sure-Board® Series 200W Structural Panels to steel framing are No. 10 - 0.19-inch (4.83 mm) minimum diameter, with a minimum 0.3145-inch (8.0 mm) diameter pan head and 0.75 inch (19.0 mm) minimum length S12 drill point screws, complying with SAE J78, ASTM C954, and C1513.

**4.2.3 Sure-Board® Series 200B Panels Attached to Steel Framing (Table 1):** The fasteners used for attaching the Sure-Board® Series 200B Structural Panels to steel framing are minimum No. 8 self-drilling S12 drill point screws with a minimum 0.138-inch (3.5 mm) diameter and minimum 1.25-inch (31.7 mm) length. The screw head is No. 2 pilot point flat head having a minimum 0.3145-inch (8.0 mm) head diameter. The screws shall comply with SAE J78 and ASTM C954 and C1513. Larger screw diameter is acceptable to use and maintain capacities listed in this report.

**4.2.4 Sure-Board® Series 200 and 200W Panels Attached to Steel Framing (Table 6):** Other fasteners for attaching Sure-Board® Series 200 and 200W Structural Panels to steel framing include power-driven fasteners (pneumatic pins) for specific assemblies listed in Table 6 of this report. The minimum ¼ inch (31.8 mm) long by 0.100-inch (2.54 mm) diameter knurled shank pneumatic nails with a minimum 5/16-inch (7.94 mm) diameter head are produced by Aerosmith Inc. and shall comply with an evaluation report issued by an approved and accredited evaluation agency.

**4.2.5 Sure-Board® Series 200W Panels Attached to Wood Framing (Table 4):** The fasteners used for attaching the Sure-Board® Series 200W Structural Panels



to wood framing are smooth shank 10d plywood nails measuring minimum 2.25 inches (57.2 mm) long by minimum 0.148-inch (3.8 mm) shank diameter.

**4.2.6 Sure-Board® Series 200 Panels Attached to Wood Framing (Table 5):** The fasteners used for attaching the Sure-Board® Series 200 Structural Panels to wood framing are No. 8 by minimum 2-inch (50.8 mm) long drywall wood screws.

### 4.3 Steel Framing

**4.3.1** In this report, for steel framing members, the following gage reference numbers, and corresponding minimum design base-metal thicknesses shall apply:

No. 14 gage: 0.071 inch (1.81 mm)

No. 16 gage: 0.054 inch (1.37 mm)

No. 18 gage: 0.043 inch (1.09 mm)

No. 20 gage: 0.033 inch (0.84 mm)

**4.3.2** Steel studs for shear walls are C-shaped, with a minimum depth of 3½ inches (89 mm) and a minimum flange width of 1⅝ inches (41 mm), with a ⅜-inch (9.5 mm) return lip for C-shaped stud. Tracks shall be a minimum of 3½ inches (89 mm) wide, with minimum 1¼-inch (31.7 mm) high flanges.

**4.3.3** No. 14 and No. 16 gage steel members shall comply with ASTM A653 CS Grade 50, with minimum yield and tensile strengths of 50 ksi (340 MPa) and 65 ksi (450 MPa), respectively. The No. 18 and No. 20 gage members shall comply with ASTM A653 CS Grade 33, with minimum yield and tensile strengths of 33 ksi (230 MPa) and 45 ksi (310 MPa), respectively. Structural design shall be performed by the design professional in accordance with Section 2211.1 of the 2018 IBC, Section 2211.6 of the 2015 and 2012 IBC, Section 2210.6 of the 2009 IBC, Section R301.1.3 of the IRC, AISI S100, and ASCE/SEI 7. Collector posts at each end of shear wall shall be minimum double stud and same gage as framing material, except as described in footnote 10 to Table 1 of this report. Actual collectors may be increased to larger or heavier gage element, as determined by the design professional.

**4.3.3 IRC:** Walls constructed in accordance with this report may be used in lieu of provisions in IRC Section 603. Steel framing shall be designed to resist all applicable loading conditions.

### 4.4 Wood Framing

**4.4.1** Minimum framing members are Stud or Construction grade Douglas Fir (D.F.) or equal with a minimum Specific Gravity (S.G.) of 0.49, conforming to Chapter 23 of the IBC and IRC. Minimum framing member size for shear walls shall be nominal 2 by 4 studs.

**4.4.2** End Posts for shear walls shall be minimum 4 by 4 No. 1 grade Douglas Fir or equal. Sill plates for shear walls shall be minimum 2 by 4 Standard grade or better Douglas Fir or equal.

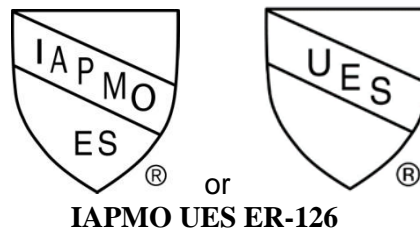
**4.4.3** Sill Plates for two-sided shear walls shall be minimum 2 by 4 Timberstrand®, 3 by 4 pressure-preservative treated Douglas Fir or equal and shall be in compliance in a current evaluation report from an approved and accredited evaluation agency.

**4.4.4** Fire-retardant-Treated wood framing material has been tested with Sure-Board® panels. All stated load capacities in Tables 4 and 5 of this report shall remain as stated in this report.

**4.4.5 IRC:** Walls constructed in accordance with this report may be used in lieu of provisions in IRC Section 602. Wood framing shall be designed to resist all applicable loading conditions.

## 5.0 IDENTIFICATION

A label shall be affixed on at least one of the following: product, packaging, installation instructions or descriptive literature. The label shall include the company name or trademark, model number, and the IAPMO Uniform ES Mark of Conformity the name of the inspection agency (when applicable) and the Evaluation Report Number (ER-126) to identify the products recognized in this report. A die-stamp label may also substitute for the label. Either Mark of Conformity may be used as shown below:



## 6.0 SUBSTANTIATING DATA

**6.1** Data in accordance with the IAPMO Uniform ES Evaluation Criteria for the Testing and Analysis of Steel Sheet Sheathing for Wood and Cold Formed Steel Light Framed Structure Shear Walls (EC-003), adopted December 2018.

**6.2** Data for Diaphragm to wall gravity load shear transfer, including load tests and analyses.

**6.3** IAPMO Uniform ES approved quality control manual.



## 7.0 STATEMENT OF RECOGNITION

This evaluation report describes the results of research carried out by IAPMO Uniform Evaluation Service on Intermat's Sure-Board® Series 200, 200W, and 200B Structural Panels to assess conformance to the codes shown in Section 1.0 of this report and serves as documentation of the product certification.

**Brian Gerber, P.E., S.E.**  
**Vice President, Technical Operations**  
**Uniform Evaluation Service**

**Richard Beck, PE, CBO, MCP**  
**Vice President, Uniform Evaluation Service**

**GP Russ Chaney**  
**CEO, The IAPMO Group**

For additional information about this evaluation report please visit [www.uniform-es.org](http://www.uniform-es.org) or email us at [info@uniform-es.org](mailto:info@uniform-es.org)



**TABLE 1 – NOMINAL AND ALLOWABLE SHEAR RESISTANCE TO WIND OR SEISMIC FORCES AND DISPLACEMENT (inches) FOR SHEAR WALLS WITH SURE-BOARD® SERIES 200 / SERIES 200B STRUCTURAL PANELS ATTACHED TO LIGHT GAGE STEEL C-STUDS AT 24" O.C. MAXIMUM WITH SPACING SCREWS (pounds per foot) <sup>1</sup>**

STEEL FRAMING	FASTENER SPACING AT PANEL EDGES INCHES ON CENTER <sup>6</sup>											
	6			4			3			2		
	$V_n^{2,3,4,7}$ (plf)	$V_{asd}^{2,3,8}$ (plf)	$\Delta V_{asd}^9$ (inch)	$V_n^{2,3,4,7}$ (plf)	$V_{asd}^{2,3,8}$ (plf)	$\Delta V_{asd}^9$ (inch)	$V_n^{2,3,4,7}$ (plf)	$V_{asd}^{2,3,8}$ (plf)	$\Delta V_{asd}^9$ (inch)	$V_n^{2,3,4,7}$ (plf)	$V_{asd}^{2,3,8}$ (plf)	$\Delta V_{asd}^9$ (inch)
No. 20 (0.033 inch)	1,085	434	0.21	1,545	618	0.21	1,730	692	0.24	1,915	766	0.26
	1,543 <sup>10</sup>	617	0.17	2,211 <sup>10</sup>	885	0.22	2,486 <sup>10</sup>	977	0.22	2,537 <sup>10</sup>	906	0.16
No. 18 (0.043 inch)	1,405 <sup>10</sup>	562	0.24	1,925 <sup>10</sup>	770	0.23	2,821 <sup>10</sup>	1,126	0.25	2,989 <sup>10</sup>	1,196	0.21
No. 16 (0.054 inch)	1,697	678	0.25	2,306	922	0.25	2,957 <sup>10</sup>	1,092	0.26	3,647 <sup>10</sup>	1,253	0.28
No.16 (0.054 inch) 2-Sided	-----	-----	-----	-----	-----	-----	-----	-----	-----	5,011 <sup>10</sup>	1,710	0.28
No. 14 (0.071 inch)	-----	-----	-----	-----	-----	-----	-----	-----	-----	3,292	1,257	0.24
No. 14 (0.071 inch) 2-Sided	-----	-----	-----	-----	-----	-----	-----	-----	-----	4,635*	1,700	0.22

For SI: 1 inch = 25.4 mm, 1 lb/linear = 0.0146 N/mm.

\*Fasteners are spaced 6 inches on center maximum into intermediate framing

<sup>1</sup> These values are for short-term loads due to wind or earthquake.

<sup>2</sup> The screws are described in Section 4.2.1 and are installed in accordance with Section 3.3.2.2 of IAPMO ES ER-126.

<sup>3</sup> Tabulated values listed in tables are for panels applied to one side or two sides of a wall.

<sup>4</sup> For load and resistance factor design (LRFD) loads, the tabulated  $V_n$  load values shall be multiplied by the resistance factor 0.60 for Seismic or 0.65 for Wind.

<sup>5</sup> Section 4.3.1 in IAPMO ES ER-126, describes minimum base metal thickness associated with gages.

<sup>6</sup> All panel edges shall be blocked. Panels may be installed vertically or horizontally. Fasteners shall be spaced a maximum of 12 inches on center along intermediate framing members, except as specifically noted in Table 1 of this report.

<sup>7</sup>  $V_n$  = Nominal Strength.

<sup>8</sup>  $V_{asd}$  = ASD Design Load.

<sup>9</sup>  $\Delta V_{asd}$  = Deflection at  $V_{asd}$  design Load.

<sup>10</sup> Nominal strength is based on double c-stud collectors (end posts) to be designed and installed using one gage thicker than the framing material used in the shear wall.



**TABLE 1A - NOMINAL AND ALLOWABLE SHEAR RESISTANCE TO WIND OR EARTHQUAKE FORCES AND DISPLACEMENT (inches) FOR SHEAR WALLS WITH SURE-BOARD® SERIES 200 / SERIES 200B STRUCTURAL PANELS ATTACHED TO LIGHT GAGE STEEL C-STUDS AT 16" O.C. WITH SCREWS (pounds per foot) <sup>1</sup>**

STEEL FRAMING	FASTENER SPACING AT PANEL EDGES INCHES ON CENTER <sup>6</sup>											
	6			4			3			2		
Minimum Gage <sup>5</sup>	$V_n^{2,3,4,7}$ (plf)	$V_{asd}^{2,3,8}$ (plf)	$\Delta V_{asd}^9$ (inch)	$V_n^{2,3,4,7}$ (plf)	$V_{asd}^{2,3,8}$ (plf)	$\Delta V_{asd}^9$ (inch)	$V_n^{2,3,4,7}$ (plf)	$V_{asd}^{2,3,8}$ (plf)	$\Delta V_{asd}^9$ (inch)	$V_n^{2,3,4,7}$ (plf)	$V_{asd}^{2,3,8}$ (plf)	$\Delta V_{asd}^9$ (inch)
14 (0.071 inch) 2-Sided	-----	-----	-----	-----	-----	-----	-----	-----	-----	5,079	1,897	0.26

For SI: 1 inch = 25.4 mm, 1 lb/foot = 0.0146 N/mm.

<sup>1</sup> These values are for short-term loads due to wind or earthquake.

<sup>2</sup> The screws are described in Section 4.2.1 and are installed in accordance with Section 3.3.2.2 of IAPMO ES ER-126

<sup>3</sup> Tabulated values listed in tables are for panels applied to one side or two sides of a wall.

<sup>4</sup> For load and resistance factor design (LRFD) loads, the tabulated  $V_n$  load values shall be multiplied by the resistance factor 0.60 for Seismic or 0.65 for Wind.

<sup>5</sup> Section 4.3.1 in IAPMO ES ER-126, describes minimum base metal thickness associated with gages.

<sup>6</sup> All panel edges shall be blocked. Panels are installed vertically or horizontally. Fasteners shall be spaced a maximum of 12 inches on center along intermediate framing members.

<sup>7</sup>  $V_n$  = Nominal Strength.

<sup>8</sup>  $V_{asd}$  = ASD Design Load.

<sup>9</sup>  $\Delta V_{asd}$  = Deflection at  $V_{asd}$  design Load.

**TABLE 2 - NOMINAL AND ALLOWABLE SHEAR RESISTANCE TO WIND OR EARTHQUAKE FORCES AND DISPLACEMENT (inches) FOR SHEAR WALLS WITH SUREBOARD® SERIES 200W / SERIES 200B STRUCTURAL PANELS ATTACHED TO LIGHT GAGE STEEL C-STUDS AT 16" O.C. WITH NO. 10 SCREWS (pounds per foot) <sup>1</sup>**

STEEL FRAMING	No. 10 SCREW SPACING AT PANEL EDGES AND FIELD 2/6, INCHES ON CENTER <sup>6</sup>		
Minimum Gage <sup>5</sup>	$V_n^{2,3,4,7}$ (plf)	$V_{asd}^{2,3,8}$ (plf)	$\Delta V_{asd}^9$ (inch)
No. 18-Ga. (0.043 in.)	2,168	703	0.14
No. 16-Ga. (0.054 in.)	2,704	923	0.18
No. 14-Ga. (0.071 in.)	2,755	934	0.15
No. 14-Ga. (0.071 in.) 2 Sided	5,091	1,922	0.29

For SI: 1 inch = 25.4 mm, 1 plf = 0.0146 N/mm.

<sup>1</sup> These values are for short term loads due to wind or earthquake

<sup>2</sup> The screws as described in Section 4.2.2 and installed in accordance with Section 3.3.2.2 of IAPMO ES ER-126

<sup>3</sup> Tabulated values listed in tables are for panels applied to one side or two sides of a wall.

<sup>4</sup> For load and resistance factor design (LRFD) loads, the tabulated  $V_n$  load values shall be multiplied by the resistance factor 0.60 for Seismic or 0.65 for Wind.

<sup>5</sup> Section 4.3.1 in evaluation report IAPMO ES ER-126, describes minimum base metal thickness associated with gages.

<sup>6</sup> All panel edges shall be blocked. Panels are installed vertically or horizontally. Fasteners shall be spaced a maximum of 6 inches on center along intermediate framing members.

<sup>7</sup>  $V_n$  = Nominal Strength.

<sup>8</sup>  $V_{asd}$  = ASD Design Load.

<sup>9</sup>  $\Delta V_{asd}$  = Deflection at  $V_{asd}$  design Load.





**TABLE 3 - NOMINAL AND ALLOWABLE SHEAR RESISTANCE TO WIND OR EARTHQUAKE FORCES AND DISPLACEMENT (inches) FOR SHEAR WALLS WITH SUREBOARD® SERIES 200W / SERIES 200B STRUCTURAL PANELS ATTACHED TO LIGHT GAGE STEEL C-STUDS AT 24" O.C. WITH NO. 10 SCREWS (pounds per foot) <sup>1</sup>**

STEEL FRAMING	No. 10 SCREW SPACING AT PANEL EDGES AND FIELD 2/6, INCHES ON CENTER <sup>6</sup>		
Minimum Gage <sup>5</sup>	$V_n^{2,3,4,7}$ (plf)	$V_{asd}^{2,3,8}$ (plf)	$\Delta V_{asd}^9$ (inch)
No. 20-Ga. (0.033 in.)	1,518	505	0.11
No. 18-Ga. (0.043 in.)	1,791	631	0.12

For SI: 1 inch = 25.4 mm, 1 plf = 0.0146 N/mm.

<sup>1</sup> These values are for short term loads due to wind or earthquake

<sup>2</sup> The screws as described in Section 4.2.2 and installed in accordance with Section 3.3.2.2 of IAPMO ES ER-126.

<sup>3</sup> Tabulated values listed in tables are for panels applied to one side or two sides of a wall.

<sup>4</sup> For load and resistance factor design (LRFD) loads, the tabulated  $V_n$  load values shall be multiplied by the resistance factor 0.60 for Seismic or 0.65 for Wind.

<sup>5</sup> Section 4.3.1 in evaluation report IAPMO ES ER-126, describes minimum base metal thickness associated with gages.

<sup>6</sup> All panel edges shall be blocked. Panels are installed vertically or horizontally. Fasteners shall be spaced a maximum of 6 inches on center along intermediate framing members.

<sup>7</sup>  $V_n$  = Nominal Strength.

<sup>8</sup>  $V_{asd}$  = ASD Design Load.

<sup>9</sup>  $\Delta V_{asd}$  = Deflection at  $V_{asd}$  design Load.

**TABLE 4 - NOMINAL AND ALLOWABLE SHEAR RESISTANCE TO WIND OR EARTHQUAKE FORCES AND DISPLACEMENT (inches) FOR SHEAR WALLS WITH SURE-BOARD® SERIES 200W / SERIES 200B STRUCTURAL PANELS ATTACHED TO DF STUDS AT 16" O.C. MAXIMUM WITH 10D NAILS (pounds per foot) <sup>1</sup>**

FRAMING	10d (2.25" min X .148) NAIL SPACING AT PANEL EDGES AND FIELD, INCHES ON CENTER <sup>3</sup>											
	4/6			2/6			2/6 Two Sided*			3/6		
Stud: 2 x 4 stud grade DF End post: 4 x 4 No. 1 grade DF *4 x 6 No. 1 grade DF Sill and top plate: 2 x 4 standard grade DF *Sill Plate: 2x4 TimberStrand or standard grade DF	$V_n^{2,3,4,5,6}$ (plf)	$V_{asd}^{2,3,5,7}$ (plf)	$\Delta V_{asd}^8$ (inch)	$V_n^{2,3,4,5,6}$ (plf)	$V_{asd}^{2,3,5,7}$ (plf)	$\Delta V_{asd}^8$ (inch)	$V_n^{2,3,4,5,6}$ (plf)	$V_{asd}^{2,3,5,7}$ (plf)	$\Delta V_{asd}^8$ (inch)	$V_n^{2,3,4,5,6}$ (plf)	$V_{asd}^{2,3,5,7}$ (plf)	$\Delta V_{asd}^8$ (inch)
	1,453	583	0.18	2,357	950	0.23	4,884	1,827	0.24	-----	-----	-----

For SI: 1 inch = 25.4 mm, 1 plf = 0.0146 N/mm.

<sup>1</sup> These values are for short term loads due to wind or earthquake

<sup>2</sup> The nails are described in Section 4.2.5 and are installed in accordance with Section 3.3.3.2 in IAPMO ES ER-126.

<sup>3</sup> All panel edges shall be blocked. Panels are installed vertically or horizontally. Fasteners shall be spaced a minimum of 6 inches on center along field framing members.

<sup>4</sup> For load and resistance factor design (LRFD) loads, the tabulated  $V_n$  load values shall be multiplied by the resistance factor 0.60 for Seismic or 0.65 for Wind.

<sup>5</sup> Tabulated values listed in tables are for panels applied to one side or two sides of a wall.

<sup>6</sup>  $V_n$  = Nominal Strength.

<sup>7</sup>  $V_{asd}$  = ASD Design Load.

<sup>8</sup>  $\Delta V_{asd}$  = Deflection at  $V_{asd}$  design Load.



**TABLE 5 - NOMINAL AND ALLOWABLE SHEAR RESISTANCE TO WIND OR EARTHQUAKE FORCES AND DISPLACEMENT (inches) FOR SHEAR WALLS WITH SURE-BOARD® SERIES 200 / SERIES 200B STRUCTURAL PANELS ATTACHED TO DF STUDS AT 16" O.C. WITH NO. 8 X 2" SCREWS (pounds per foot) <sup>1</sup>**

FRAMING	No. 8 X 2" SCREW SPACING AT PANEL EDGES AND FIELD, INCHES ON CENTER <sup>3</sup>					
	2/12			2/12 (2-Sided) *		
	$V_n^{2,3,4,5,6}$ (plf)	$V_{asd}^{2,3,5,7}$ (plf)	$\Delta V_{asd}^8$ (inch)	$V_n^{2,3,4,6}$ (plf)	$V_{asd}^{2,3,7}$ (plf)	$\Delta V_{asd}^8$ (inch)
Stud: 2 x 4 stud grade DF End post: 4 x 4 No. 1 grade DF Sill and top plate: 2 x 4 standard grade DF *Sill Plate: 2x4 TimberStrand or standard grade DF	2,751	1,086	0.23	4,501	1,800	0.23

For SI: 1 inch = 25.4 mm, 1 plf = 0.0146 N/mm.

<sup>1</sup> These values are for short term loads due to wind or earthquake

<sup>2</sup> The screws are described in Section 4.2.6 and are installed in accordance with Section 3.3.3.2 in IAPMO ES ER-126.

<sup>3</sup> All panel edges shall be blocked or backed. Panels are installed vertically or horizontally. Screws shall be spaced a minimum of 12 inches on center along field framing members.

<sup>4</sup> For load and resistance factor design (LRFD) loads, the tabulated  $V_n$  load values shall be multiplied by the resistance factor 0.60 for Seismic or 0.65 for Wind.

<sup>5</sup> Tabulated values listed in tables are for panels applied to one side or two sides of a wall.

<sup>6</sup>  $V_n$  = Nominal Strength.

<sup>7</sup>  $V_{asd}$  = ASD Design Load.

<sup>8</sup>  $\Delta V_{asd}$  = Deflection at  $V_{asd}$  design Load.

**TABLE 6 - NOMINAL AND ALLOWABLE SHEAR RESISTANCE TO WIND OR EARTHQUAKE FORCES AND DISPLACEMENT (inches) FOR SHEAR WALLS WITH SURE-BOARD® SERIES 200 / SERIES 200W / SERIES 200B STRUCTURAL PANELS ATTACHED TO LIGHT GAGE STEEL C-STUDS AT 16" O.C. WITH COMBINED SCREWS AND PNEUMATIC PINS MANUFACTURED BY AEROSMITH INC. (pounds per foot) <sup>1</sup>**

FRAMING	SCREW / SCREW / PIN SPACING AT PANEL EDGES AND FIELD INCHES ON CENTER <sup>3</sup>											
	2/12/2 <sup>10</sup> No. 18 gage 5/8" D/G			2/12/2 <sup>10</sup> No. 16 gage 5/8" D/G			2/12/2 <sup>10</sup> No. 18 gage 1/4" M/B			2/12/2 <sup>10</sup> No. 16 gage 1/4" M/B		
	$V_n^{2,3,4,5,7}$ (plf)	$V_{asd}^{2,3,5,8}$ (plf)	$\Delta V_{asd}^9$ (inch)	$V_n^{2,3,4,5,7}$ (plf)	$V_{asd}^{2,3,5,8}$ (plf)	$\Delta V_{asd}^9$ (inch)	$V_n^{2,3,4,5,7}$ (plf)	$V_{asd}^{2,3,5,8}$ (plf)	$\Delta V_{asd}^9$ (inch)	$V_n^{2,3,4,5,7}$ (plf)	$V_{asd}^{2,3,5,8}$ (plf)	$\Delta V_{asd}^9$ (inch)
No. 18 gage <sup>6</sup> 3 5/8" C-stud @ 16" O.C.	2,449	975	0.21	2,825	1,100	0.24	2,201	811	0.17	2,495	932	0.19
No. 16 gage <sup>6</sup> 3 5/8" C-stud @ 16" O.C.												

For SI: 1 inch = 25.4 mm, 1 plf = 0.0146 N/mm.

<sup>1</sup> These values are for short term loads due to wind or earthquake

<sup>2</sup> The pins and screws are described in Section 4.2.4 and are installed in accordance with Section 3.3.2.2 in IAPMO ES ER-126.

<sup>3</sup> All panel edges shall be blocked. Panels are installed vertically or horizontally. Fasteners shall be spaced a minimum of 12 inches on center along field framing members.

<sup>4</sup> For load and resistance factor design (LRFD) loads, the tabulated  $V_n$  load values shall be multiplied by the resistance factor 0.60 for Seismic / 0.65 for Wind.

<sup>5</sup> Tabulated values listed in tables are for panels applied to one side or two sides of a wall.

<sup>6</sup> Section 3.3.2.1 in evaluation report IAPMO ES ER-126, describes minimum base metal thickness associated with gages.

<sup>7</sup>  $V_n$  = Nominal Strength.






<sup>8</sup>  $V_{asd}$  = ASD Design Load.

<sup>9</sup>  $\Delta V_{asd}$  = Deflection at  $V_{asd}$  design Load.

<sup>10</sup> Fastener Schedule:

**A)** All top/bottom track screwed only with No. 8 x 1 1/4 inch long self-tapping screws spaced at 2 inches on center maximum. **B)** No. 8 x 1 1/4 inch long self-tapping screws spaced at 12 inches on center maximum at all vertical studs/posts. **C)** 1 1/4 inch long x 0.100-inch diameter knurled shank for DensGlass Gold (**D/G**) and 1 1/4 inch long x 0.100-inch diameter for Magnesium Oxide Board MgO (**M/B**) both spaced at 2" on center maximum. (Designation for fasteners **A)** = 2" o.c. **B)** = 12" o.c. **C)** = 2" o.c.)

**Table 8. Diaphragm-to-Wall Gravity Load Shear Transfer Nominal Strength** <sup>1, 2, 3, 4, 5, 6</sup>

Case	Description ( <i>detailing for in-plane wall shear is the responsibility of the design professional of record</i> )	Illustrated Framing	Nominal strength, plf
1	Diaphragm ledger attached directly to wall framing.		3,021
2	Sure-Board® Series 200–5/8 in. Type X gypsum composite panel interposed/sandwiched between ledger and wall framing.		3,144
3	Sure-Board® Series 200–5/8 in. Type X gypsum composite panel interposed/sandwiched between ledger and wall framing <b>and</b> Sure-Board® Series 200SF floor sheathing continuous across ledger-to-wall interface to top of wall. Floor sheathing connected to top of wall with No. 8 screws at 6 inches on center maximum.		5,922
4	Sure-Board® Series 200–5/8 in. Type X gypsum composite panel with the gypsum panel terminating below joists and the steel sheet extending along the joist between ledger and wall framing.		4,764
5	54 mil steel plate interposed/sandwiched between ledger and wall framing with Sure-Board® Series 200–5/8 in. Type X gypsum composite panel attached to 54 mil plate below joists via a 2-in. panel-plate lap joint.		5545

1. Ledger attached to wall with a minimum of two No. 12 screws at each stud.
2. Joists attached to ledger with a 54-mil clip-angle and three No. 10 screws each leg, minimum.
3. In line framing. Joists and wall studs are 24 inches on center maximum.
4. Case 3— Sure-Board® Series 200SF floor sheathing attached to joists with No. 8 screws at 6 inches on center at sheathing perimeter maximum. Series 200SF floor sheathing shall comply with ER-185.
5. Case 5—54 mil plate attached to wall framing and wall sheathing with No. 8 screws at 6 inches on center maximum.
6. Available strength shall be determine using  $\phi = 0.5$  for Load and Resistance Factor Design (LRFD) and  $\Omega = 3.0$  for allowable stress design (ASD).



## CALIFORNIA SUPPLEMENT

### INTERMAT

2045 Placentia Avenue  
Costa mesa, California 92627

[www.sureboard.com](http://www.sureboard.com)  
[support@sureboard.com](mailto:support@sureboard.com)

### SURE-BOARD® SERIES 200, 200W, AND 200B STRUCTURAL PANELS INSTALLED ON COLD-FORMED STEEL OR WOOD FRAMED SHEAR WALLS

CSI Section: 05160-Metal Framing Systems

## 1.0 SCOPE OF EVALUATION

### 1.1 Compliance with the following codes:

- 2019 and 2016 California Building Code® (CBC)

**1.2 Recognition:** The Sure-Board® Series 200, 200W, and 200B Structural Panels evaluated in IAPMO UES ER-126 comply with the CBC, subject to Additional Requirements in Sections 2.0, 3.0, 4.0, 5.0, and 6.0 of this supplement.

## 2.0 PRODUCT USE

The structural panels are alternatives to Cold-Formed Steel or Wood stud shear wall systems described in Sections 2211 and 2305, respectively, of the 2019 and 2016 CBC.

## 3.0 PRODUCT DESCRIPTION

**3.1 Steel Framing:** Steel framing shall be in accordance with Section 2211 of the CBC.

**3.2 Wood Framing:** Minimum framing members shall conform to Chapter 23 of the CBC.

## 4.0 DESIGN AND INSTALLATION

**4.1 Shear Wall Design:** Design provisions in Sections 3.2 of ER-126 shall apply to the CBC except where modified as follows. The Nominal ( $V_n$ ) and Allowable Stress Design ( $V_{asd}$ ) shear values for wind and earthquake forces are shown in Tables 1, 1A, 2, 3, 4, 5, and 6 of ER-126 with associated deflections for shear walls using Sure-Board® Series 200, 200W, and 200B Structural Panels attached to Cold-Formed Steel or Wood studs. Nominal shear values shall be multiplied by the appropriate strength reduction factor to determine LRFD design strength in accordance with footnote 4 of Tables 1, 1A, 2, 3, 4, 5, and 6 of ER-126 as set forth in Section 2211.1 of the 2018 IBC, Section 2211.6 or Section 2305 of the 2015 or 2012 IBC.

The collector design shall comply with the CBC and sized to exceed the loads resisted by the shear wall. Wall anchorage

shall comply with CBC Section 2212.5.2 or 2211A.4, as applicable.

Cold-Formed Steel or Wood framing design for out-of-plane and axial loads shall comply with the CBC. For installation in Seismic Design Category C, D, E, and F, additional requirements for steel framing in Section 2211 of the CBC shall be observed.

## 4.2 Installation

**4.2.1 Steel/Wood Framing:** Installation provisions in Section 3.3 of ER-126 shall apply to the CBC except where modified as follows. Sure-Board® Series 200, 200W, and 200B Structural Panels are placed with the long dimension parallel or perpendicular to stud framing. The steel face shall be in contact with the framing. All panel edges, top and bottom shall be fully blocked by framing studs, track, blocking, or flat strap of the same gage as the framing material and include an end collector element to be determined by the Design Professional and the registered design professional using the CBC.

## 5.0 LIMITATIONS

The Sure-Board® Series 200, 200W, and 200B Structural Panels, described in ER-126 and this report supplement, comply with the codes listed in Section 1.1 of this supplement, subject to the conditions in ER-126, except where modified as follows:

**5.2** The Nominal ( $V_n$ ) and Allowable Stress Design ( $V_{asd}$ ) shear values for wind and earthquake forces are shown in Tables 1, 1A, 2, 3, 4, 5, and 6 of ER-126. To determine the LRFD design values, the appropriate strength reduction factor, in accordance with Section 2211 or 2305 of the CBC shall be applied.

**5.3** Applied loads shall be adjusted in accordance with Section 1605 or 1605A of the CBC. Calculations shall demonstrate in addition to other requirements as stipulated by the building official, that the applied loads are less than the design loads described in CBC and this report.

## 6.0 SUBSTANTIATING DATA

Data in accordance with the IAPMO Uniform ES Evaluation Criteria for the Testing and Analysis of Steel Sheet Sheathing for Wood and Cold Formed Steel Light Framed Structure Shear Walls (EC-003), adopted December 2018.

**6.2** Data for Diaphragm to wall gravity load shear transfer, including load tests and analyses.

**6.3** IAPMO Uniform ES approved quality control manual.

For additional information about this evaluation report please visit [www.uniform-es.org](http://www.uniform-es.org) or email at [info@uniform-es.org](mailto:info@uniform-es.org)