


SYSTEM NO. HW-D-0623

ANSI/UL2079
Assembly Ratings - 1 and 2 Hr

Nominal Joint Width - See Chart, Section 3
Class II or III Movement Capabilities - See Chart, Section 3

--
--

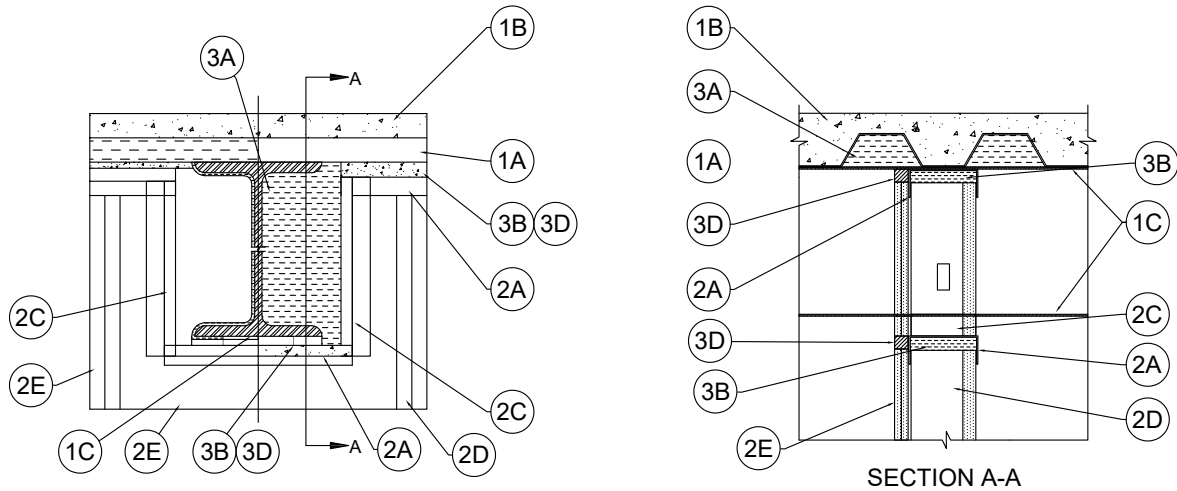

1. **Floor Assembly** — The fire-rated fluted steel deck/concrete floor assembly shall be constructed of the materials and in the manner described in the individual D700 or D900 Series Floor-Ceiling Design in the UL Fire Resistance Directory and shall include the following construction features:
- A. **Steel Floor and Form Units*** — Max 3 in. (76 mm) deep galv steel fluted floor units.
 - B. **Concrete** — Min 2-1/2 in. (64 mm) thick reinforced concrete, as measured from the top plane of the floor units.
 - C. **Structural Steel Support** — Steel Beam or open web steel joist, as specified in the individual D900 Series Floor- Ceiling Design, used to support steel floor units. Structural steel support oriented perpendicular to wall assembly.
 - D. **Spray-Applied Fire Resistive Material*** — (Not shown) - As specified in the D700 or D900 Series Floor-Ceiling Design after installation of the steel floor units, ceiling runner (Item 3), attachment clips (Item 2B), and track frame (Item 2C), all surfaces of the structural steel support to be sprayed with the thickness of material specified in the individual design. The area between the structural steel support, track frame (Item 2C), and surrounding both sides of the attachment clips (Item 2B) are to be filled with material to a combined thickness of the wall framing when forming material (Item 3A) is not used.

ISOLATEK INTERNATIONAL — Type 300
GCP APPLIED TECHNOLOGIES INC — Type MK-6/HY

- 1A. **Floor Assembly** — (Not Shown) - As an alternate to the floor assembly, a fire rated fluted steel deck roof assembly may be used. The roof shall be constructed of the materials and in the manner described in the individual P700 or P900-Series Roof-Ceiling designs in the UL Fire Resistance Directory. The hourly rating of the roof assembly shall be equal to or greater than the hourly rating of the wall assembly. The roof assembly shall include the following construction features:
- A. **Steel Roof Deck** — Max 3 in. (76 mm) deep galv steel fluted roof deck.
 - B. **Roof Insulation** — Roof insulation to consist of min 2-1/4 in. (57 mm) thick poured insulating concrete, as measured from the top plane of the roof deck.
 - C. **Structural Steel Support** — Steel Beam, as specified in the individual P900 Series Roof-Ceiling Design, used to support steel floor units. Steel Beam oriented perpendicular to wall assembly.
 - D. **Spray-Applied Fire Resistive Material*** — As specified in the individual P700 or P900 Series Floor-Ceiling Design after installation of the ceiling runner (Item 3C), attachment clips (Item 2B), track frame (Item 2C), all surfaces of the structural steel support to be sprayed with the thickness of material as specified in the individual design. The area between the structural steel support, track frame (Item 2C), and surrounding both sides of the attachment clips (Item 2B) are to be filled with material to a combined thickness of the wall framing when forming material (Item 3A) is not used.

ISOLATEK INTERNATIONAL — Type 300
GCP APPLIED TECHNOLOGIES INC — Type MK-6/HY

2. **Wall Assembly** — The 1 or 2 hr fire rated gypsum board/stud wall assembly shall be constructed of the materials and in the manner described in the individual U400 or V400 Series Wall and Partition Design in the UL Fire Resistance Directory and shall include the following construction features:
- A. **Steel Floor and Ceiling Runners** — Floor and ceiling runners of wall assembly shall consist of min No. 25 ga galv steel channels sized to accommodate steel studs (Item 2D). Floor and ceiling runner to be provided with min 1-1/4 in. (32mm) legs with slotted leg toward finished

SYSTEM NO. HW-D-0623

ANSI/UL2079
Assembly Ratings - 1 and 2 Hr

Nominal Joint Width - See Chart, Section 3
Class II or III Movement Capabilities - See Chart, Section 3

--
--

side of wall. Legs are to be min 1/4 in. (6 mm) longer than the maximum joint width. The floor or ceiling runners are provided with a fill, void or cavity material and are described in Item 3C. Floor or ceiling runner to be attached to steel deck (after spray-applied fire resistive material is applied, if used) with steel fasteners spaced a max of 24 in. (610 mm) O.C. Ceiling runner to be attached to steel attachment clips (Item 2B) with steel fasteners or welds spaced a max of 16 in. (406 mm) O.C.

A1. **Light Gauge Framing*** — Slotted Ceiling Track — (Not Shown) - As an alternate to the Item 2A, a ceiling track consisting of galv steel channel with slotted flanges may be used when Item 3D.2 or 3D.2.1 fill material is utilized. Slotted ceiling track sized to accommodate steel studs (Item 2C). Legs are to be min 1/4 in. (6 mm) longer than the maximum joint width. Attached to steel deck with steel fasteners or welds spaced max 24 in. (610 mm) OC.

BRADY CONSTRUCTION INNOVATIONS INC, DBA SLIPTRACK SYSTEMS — SLP-TRK
CALIFORNIA EXPANDED METAL PRODUCTS CO — CST, CST 325
MARINO/WARE, DIV OF WARE INDUSTRIES INC — Type SLT

- B. **Steel Attachment Clips** — Min two Z-shaped clips formed from min 20 ga galv steel. Clips are to be attached along the bottom flange of beam (prior to application of spray-applied fire-resistive materials) with steel fasteners or welds.
- C. **Studs** — "C-T", "I", or "C-H" shaped steel studs to be min 2 1/2 in. (64 mm) wide and formed of min 24 ga galv steel. Studs cut 1 to 1-1/4 or 2-2-1/4 (25 to 32 or 51 to 57 mm) less in length than assembly height for joint widths of 1/2 or 1 in. (13 or 25 mm) respectively with bottom nesting in and secured to floor runner. Steel studs secured to slotted leg of ceiling runner on finished side with No. 8 by 1/2 (13 mm) long wafer head steel screws at mid-height of exposed slot. Studs spaced max 24 in. (610 mm) OC.
- D. **Gypsum Board*** — 1 in. (25 mm) thick by max 24 in. (610 mm) wide gypsum board liner panels. Panels cut 1-1/4 to 1-1/2 in. (32 to 38 mm) less in length than floor to ceiling height. Vertical edges inserted into "T" shaped section of "C-T" studs, into holding tabs of "I" studs or into "H"-shaped section of "C-H" studs. The gypsum board shall be cut to profile the structural steel support with a maximum separation of 5/8 in. or 1 in. (16 or 25 mm) for 5/8 in. (16 mm) and 1 in. (25 mm) joints, respectively, between the lowest surface point of the spray applied material on the steel.
- E. **Gypsum Board*** — Gypsum board sheets installed to a min total 5/8 in. (16 mm) or 1-1/4 in. (32 mm) thickness on each side of wall for 1 and 2 hr fire rated assemblies, respectively. Wall to be constructed as specified in the individual U400 or V400 Series Design in the UL Fire Resistance Directory except that a max 5/8 in. or 1 in. (16 mm or 25) gap shall be maintained between the top of the gypsum board, the steel floor units. The gypsum board shall be cut to profile the structural steel support with a maximum separation of 5/8 in. or 1 in. (16 or 25 mm) for 5/8 in. (16 mm) and 1 in. (25 mm) Joints respectively, between the lowest surface point of the spray applied material on the steel. The screws attaching the gypsum board layer(s) to the "C-T", "I", or "C-H" studs shall be located 4 to 5 in. (102 to 127 mm) down from deck at time of installation. No gypsum board attachment screws shall be driven into the ceiling runner or the steel track frame (Item 2D).

The hourly fire rating of the joint system is equal to the hourly fire rating of the wall.

3. **Joint System** — Max separation between steel floor unit, spray applied material on bottom flange of structural support, and top of gypsum board (at time of installation) is 5/8 in. (16 mm) or 1 in. (25 mm). The joint system is designed to accommodate a max 100 percent compression or extension from its installed width. When item 2A.1 is used max nominal width is 3/4 in. (19 mm). When item 3D.2.1 is used the max nominal gap is 1/2 in. (13 mm). When Item 3D.3 is used the nominal gap is 3/8 in. (10 mm). When item 3E4 is used the joint will accommodate 100% compression/extension for nominal 1/4 in. (6mm) gaps or compression only for 1/2 in. (12mm) gaps.

- A. **Forming Material*** — Nom 4 pcf mineral wool batt insulation cut into strips having a thickness of the wall stacked to maintain a sufficient 50 percent compression between the structural steel support web and the steel track frame (Item 2D). Mineral wool to cover entire area between the structural steel support and the steel track frame.

INDUSTRIAL INSULATION GROUP L L C — MinWool-1200 Safing
JOHNS MANVILLE — Safing
ROCK WOOL MANUFACTURING CO — Delta Safing Board
ROCKWOOL MALAYSIA SDN BHD — SAFE
ROCKWOOL — SAFE
THERMAFIBER INC — SAF

- B. **Forming Material*** — Min 2 in. thick min 4 pcf (64 kg/m3) mineral wool batt insulation cut to friction fit 33 percent compression in width and installed into ceiling runner between leg of track and gypsum liner board.

INDUSTRIAL INSULATION GROUP L L C — MinWool-1200 Safing
JOHNS MANVILLE — Safing
ROCK WOOL MANUFACTURING CO — Delta Safing Board
ROCKWOOL MALAYSIA SDN BHD — SAFE
ROCKWOOL — SAFE
THERMAFIBER INC — SAF



Reproduced Courtesy of Underwriters Laboratories, Inc.
Created or Revised: September 27, 2021

CEMCO® | P: (800) 775-2362 | F: (626) 330-7598 | www.cemcosteel.com



SYSTEM NO. HW-D-0623

ANSI/UL2079
Assembly Ratings - 1 and 2 Hr

Nominal Joint Width - See Chart, Section 3
Class II or III Movement Capabilities - See Chart, Section 3

--
--

- C. **Forming material*** — Nom 4 pcf mineral wool batt insulation cut to the shape of the fluted steel floor units, approx 33% larger than the area of the flutes. Pieces compressed and inserted into the flutes above the top ceiling runner flush with the finished wall surface.

INDUSTRIAL INSULATION GROUP LLC — MinWool-1200 Safing
JOHNS MANVILLE — Safing
ROCK WOOL MANUFACTURING CO — Delta Safing Board
ROCKWOOL MALAYSIA SDN BHD — SAFE
ROCKWOOL — SAFE
THERMAFIBER INC — SAF

- C1. **Forming Material*-Plugs** — (Not Shown) — As an alternate to the forming material (Item 3B), mineral wool plugs preformed to the shape of the fluted floor units or roof deck, may be used within the flutes. Plugs shall be friction fitted to completely fill the flutes.

ROCK WOOL MANUFACTURING CO — Delta Deck Plugs

Item	Product	Max Gap	Movement
3D	DDA (CEMCO)	1"	100% Comp 100% Ext
3D1	DDA-1 (CEMCO)	1/2"	100% Comp 100% Ext
3D2	Fire Rated J-Track (CEMCO, MARINO/WARE)	3/8"	100% Comp 100% Ext
3D2	USG Sheetrock® Brand Firecode® J-Runner	3/8"	100% Comp 100% Ext
3D3	DDA (CEMCO)	1"	100% Comp 100% Ext
3D4	DDA-1 (CEMCO)	1/2"	100% Comp 100% Ext
3D5	Fire Gasket 1 (CEMCO, MARINO/WARE, TRIM-TEX)	1/2"	100% Comp 100% Ext
3D6	Fire Gasket 1.5 (CEMCO, MARINO/WARE, TRIM-TEX)	3/4"	100% Comp 100% Ext
3D7	Fire Gasket 0.5 (CEMCO, MARINO/WARE, TRIM-TEX)	1/4"	100% Comp 100% Ext

- E. **Fill, Void or Cavity Material*** — (Optional, Not Shown) when items 3D3 and 3D4 are utilized a min 1/16 in. (1.6 mm) dry thickness (min 1/8 in. or 3.2 mm wet thickness) of fill material sprayed or brushed on one side of the joint system, completely covering item 3A mineral wool forming material of the joint system and overlapping a min of 1/2 in. (13 mm) onto the steel deck and item 2C on the finish side of wall.

RECTORSEAL — Metacaulk 1200, Biostop 750, FlameSafe FS3000, Metacaulk 1500, or Biostop 800 Spray.

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2021 UL LLC"



Reproduced Courtesy of Underwriters Laboratories, Inc.
Created or Revised: September 27, 2021

CEMCO® | P: (800) 775-2362 | F: (626) 330-7598 | www.cemcosteel.com

